

		LUZON					
FUEL TYPE	Capac	ity (MW)	Percent Share (%)				
	Installed	Dependable	Installed	Dependable			
Coal	9,392	8,589	41.8	43.4			
Oil Based	2,054	1,566	9.2	7.9			
Diesel	937	721	4.2	3.6			
Oil Thermal	350	305	1.6	1.5			
Gas Turbine	767	540	3.4	2.7			
Natural Gas	4,611	4,124	20.5	20.9			
Renewable Energy	6,388	5,499	28.5	27.8			
Biomass	175	145	0.8	0.7			
Biomass	167	142	0.7	0.7			
Waste to Energy (WTE)	8	3	0.0	0.0			
Geothermal	900	742	4.0	3.8			
Solar	2,414	1,889	10.8	9.5			
Behind-the-Meter (BTM)	46	44	0.2	0.2			
Ground-Mounted	2,368	1,845	10.6	9.3			
Hydro	2,563	2,386	11.4	12.1			
Impounding Hydro	1,418	1,316	6.3	6.7			
Pumped Hydro	736	720	3.3	3.6			
Run-of-River (ROR)	409	351	1.8	1.8			
Wind	337	337	1.5	1.7			
Onshore Wind	337	337	1.5	1.7			
Off-shore Wind (OSW)	0	0	0.0	0.0			
TOTAL	22,445	19,778	100.0	100.0			
Energy Storage System (ESS)	363	341					
Battery ESS	363	341					
Hybrid ESS	0	0	<u> </u>				

TYPE OF CONNECTION		LUZ	LUZON			
	Capacity (MW)		Percent Share (%)			
	Installed	Dependable	Installed	Dependable		
Grid Connected	21,420	19,148	95.4	96.8		
Embedded	1,025	629	4.6	3.2		
TOTAL	22,445	19,778	100.0	100.0		
Energy Storage System (ESS)	363	341				
Battery ESS	363	341				
Hybrid ESS	0	0				

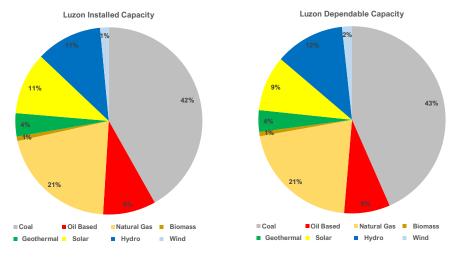


		VISAYAS					
FUEL TYPE	Capac	ity (MW)	Percent Share (%)				
	Installed	Dependable	Installed	Dependable			
Coal	1,346	1,233	35.3	37.9			
Oil Based	517	409	13.5	12.6			
Diesel	506	399	13.3	12.3			
Oil Thermal	11	11	0.3	0.3			
Gas Turbine	0	0	0.0	0.0			
Natural Gas	1	0	0.0	0.0			
Renewable Energy	1,951	1,609	51.1	49.5			
Biomass	326	191	8.5	5.9			
Biomass	326	191	8.5	5.9			
Waste to Energy (WTE)	0	0	0.0	0.0			
Geothermal	975	888	25.6	27.3			
Solar	505	411	13.2	12.7			
Behind-the-Meter (BTM)	0	0	0.0	0.0			
Ground-Mounted	505	411	13.2	12.7			
Hydro	55	44	1.4	1.4			
Impounding Hydro	0	0	0.0	0.0			
Pumped Hydro	0	0	0.0	0.0			
Run-of-River (ROR)	55	44	1.4	1.4			
Wind	90	75	2.4	2.3			
Onshore Wind	90	75	2.4	2.3			
Off-shore Wind (OSW)	0	0	0.0	0.0			
TOTAL	3,815	3,252	100.0	100.0			
Energy Storage System (ESS)	129	122					
Battery ESS	129	122					
Hybrid ESS	0	0					

		VISAYAS				
TYPE OF CONNECTION	Capacity (MW)		Percent Share (%)			
	Installed	Dependable	Installed	Dependable		
Grid Connected	3,681	3,133	96.5	96.4		
Embedded	134	119	3.5	3.6		
TOTAL	3,815	3,252	100.0	100.0		
Energy Storage System (ESS)	129	122				
Battery ESS	129	122				
Hybrid ESS	0	0				

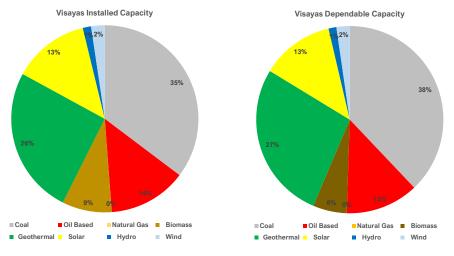


		MINDANAO					
FUEL TYPE	Capaci	ity (MW)	Percent	Percent Share (%)			
	Installed	Dependable	Installed	Dependable			
Coal	2,268	2,041	49.1	50.8			
Oil Based	833	708	18.1	17.6			
Diesel	833	708	18.1	17.6			
Oil Thermal	0	0	0.0	0.0			
Gas Turbine	0	0	0.0	0.0			
Natural Gas	0	0	0.0	0.0			
Renewable Energy	1,513	1,271	32.8	31.6			
Biomass	95	37	2.1	0.9			
Biomass	95	37	2.1	0.9			
Waste to Energy (WTE)	0	0	0.0	0.0			
Geothermal	112	106	2.4	2.6			
Solar	84	68	1.8	1.7			
Behind-the-Meter (BTM)	0	0	0.0	0.0			
Ground-Mounted	84	68	1.8	1.7			
Hydro	1,223	1,059	26.5	26.3			
Impounding Hydro	747	619	16.2	15.4			
Pumped Hydro	0	0	0.0	0.0			
Run-of-River (ROR)	476	440	10.3	10.9			
Wind	0	0	0.0	0.0			
Onshore Wind	0	0	0.0	0.0			
Off-shore Wind (OSW)	0	0	0.0	0.0			
TOTAL	4,615	4,020	100.0	100.0			
Energy Storage System (ESS)	142	136					
Battery ESS	93	87					
Hybrid ESS	49	49					


TYPE OF CONNECTION		MINDA	MINDANAO			
	Capacity (MW)		Percent Share (%)			
	Installed	Dependable	Installed	Dependable		
Grid Connected	3,763	3,291	81.5	81.9		
Embedded	852	729	18.5	18.1		
TOTAL	4,615	4,020	100.0	100.0		
Energy Storage System (ESS)	142	136				
Battery ESS	93	87				
Hybrid ESS	49	49				

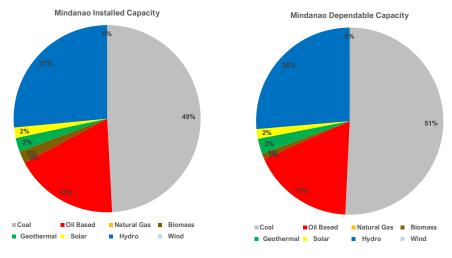

		PHILIPPINES					
FUEL TYPE	Capac	ity (MW)	Percent Share (%)				
	Installed	Dependable	Installed	Dependable			
Coal	13,006	11,863	42.1	43.9			
Oil Based	3,404	2,684	11.0	9.9			
Diesel	2,276	1,828	7.4	6.8			
Oil Thermal	361	316	1.2	1.2			
Gas Turbine	767	540	2.5	2.0			
Natural Gas	4,612	4,124	14.9	15.2			
Renewable Energy	9,853	8,379	31.9	31.0			
Biomass	595	374	1.9	1.4			
Biomass	587	370	1.9	1.4			
Waste to Energy (WTE)	8	3	0.0	0.0			
Geothermal	1,987	1,736	6.4	6.4			
Solar	3,003	2,368	9.7	8.8			
Behind-the-Meter (BTM)	46	44	0.1	0.2			
Ground-Mounted	2,957	2,325	9.6	8.6			
Hydro	3,841	3,490	12.4	12.9			
Impounding Hydro	2,164	1,935	7.0	7.2			
Pumped Hydro	736	720	2.4	2.7			
Run-of-River (ROR)	940	835	3.0	3.1			
Wind	427	412	1.4	1.5			
Onshore Wind	427	412	1.4	1.5			
Off-shore Wind (OSW)	0	0	0.0	0.0			
TOTAL	30,875	27,050	100.0	100.0			
Energy Storage System (ESS)	634	599					
Battery ESS	585	550					
Hybrid (Diesel-Battery System)	49	49	-				

TYPE OF CONNECTION		PHILIP	PINES			
	Capacity (MW)		Percent Share (%)			
	Installed	Dependable	Installed	Dependable		
Grid Connected	28,864	25,573	93.5	94.5		
Embedded	2,011	1,477	6.5	5.5		
TOTAL	30,875	27,050	100.0	100.0		
Energy Storage System (ESS)	634	599				
Battery ESS	585	550				
Hybrid ESS	49	49				





Note:

Excluding off-grid generators

Released as of 30 April 2025

Installed Capacity - nameplate capacity; full-load continuous gross capacity of a unit under specified conditions, as calculated from the electric generator nameplate based on the rated power factor.

Dependable Capacity - maximum capacity when modified for ambient limitations for a specified period of time, such as a month or a season.

Installed and Dependable Capacity values may be updated as necessary.

For Solar Power Plants: Installed Capacity are MWP or MWDC values while Dependable Capacity are MWAC values

GRID	Capaci	ty (MW)	Percent Share (%)		Number of
GNID	Installed	Dependable	Installed	Dependable	<b>Power Plants</b>
LUZON	22,445	19,778	72.7	73.1	164
VISAYAS	3,815	3,252	12.4	12.0	64
MINDANAO	4,615	4,020	14.9	14.9	77
TOTAL	30,875	27,050	100.0	100.0	305